

# Temperature Controls Pty Ltd



7 YAMMA STREET SEFTON, NSW 2162 AUSTRALIA

Phone: 61 2 9721 8644

Fax: 61 2 9738 9339

Web: [www.temperature.com.au](http://www.temperature.com.au)

Email: [sales@temperature.com.au](mailto:sales@temperature.com.au)

ACN: 650 190 183 ABN: 966 501 901 83

ISO 9001

Lic: 14412

**THERMOCOUPLES \* RTD SENSORS \* THERMOWELLS \* EXTENSION CABLES \* LEVEL SWITCHES**

15/12/06

Ref: #7 INTERNAL PRESSURE TEST FLANGED (1043)

## **WELDING QUALIFICATION CERTIFICATE** **WELDING PROCEDURE SPECIFICATION & PRESSURE TEST**

**Customer:**

**Order No:**

**Tag No:**

This certificate is to confirm the Barstock Thermowell supplied against the above order number were subject to the following tests.

### **(i) HYDRAULIC PRESSURE TEST PROCEDURE - BARSTOCK THERMOWELLS**

Thermowells were subjected to an internal hydraulic pressure test of 38,000 KPa for a duration of six minutes.

Each Thermowell was individually tested on our Hydraulic Pressure Comparator. The test pressure gauge is traceable N.A.T.A. test pressure Gauge No. 07/03/013.

### **(ii) FOUR PART DYE PENETRANT TEST - FLANGED THERMOWELLS**

*In Accordance to AS.2062-1997 "Methods for non-destructive penetrant testing of testing of products and components and BPV Code, Section V, Article 6 referenced by ASME B31.3 standard for Liquid Penetrant Testing.*

All Thermowell flanges were subjected to a four part dye Penetrant test using flaw check dye Penetrant spray.

### **(iii) WELDING PROCEDURE SPECIFICATION - FLANGED THERMOWELLS**

*In Accordance to AS1210 - SAA Unfired Pressure Vessel Code*

#### **Welding**

**Full penetration welding**, Primary weld is "J" groove type, secondary weld is "J" groove type.

Welding is performed by certified welders using inert gas shielded arc.

Individual welding procedure specifications detailing materials used, method of welding, joint type and material specification are available on request.

**RAISED FACE:** Sealing Finish. Standard RA 16 option 12.5, 8, 6.3, 3.2, 1.6, 0.8 & 0.4.

All Thermowells passed the test without failure.

Michael Donnelly  
Testing Officer

**MELBOURNE OFFICE: PHONE (03) 9687 0000 FAX: (03) 9687 1900**  
**PROUDLY MANUFACTURING IN AUSTRALIA**

# Temperature Controls Pty Ltd



7 YAMMA STREET SEFTON, NSW 2162 AUSTRALIA

Phone: 61 2 9721 8644

Fax: 61 2 9738 9339

Web: [www.temperature.com.au](http://www.temperature.com.au)

Email: [sales@temperature.com.au](mailto:sales@temperature.com.au)

ACN: 650 190 183 ABN: 966 501 901 83

ISO 9001


Lic: 14412

**THERMOCOUPLES \* RTD SENSORS \* THERMOWELLS \* EXTENSION CABLES \* LEVEL SWITCHES**

## Welding Procedure Specification PARTIAL PENETRATION SD 1371

<b>Weld Procedure Number &amp; Date</b>	<b>WPS 17/05</b>
<b>Welding Procedure Specification</b>	<b>SZ20</b>

Manufacturer:	Temperature Controls 7 Yamma Street Sefton NSW 2162 Australia	Method Of Preparation and Cleaning:	Machine and Degrease
Location:	Workshop	Base metal # 1 Specification:	1.4435 316L
Welding Process:	GTAW	Base Metal # 1 Thickness	20.7mm
Joint Type:	Double J Groove	Base metal # 1 Specification:	1.4435 316L
		Base Metal # 1 Thickness	31.75mm
		Welding Position:	Down hand
		Welding Progression:	Bead

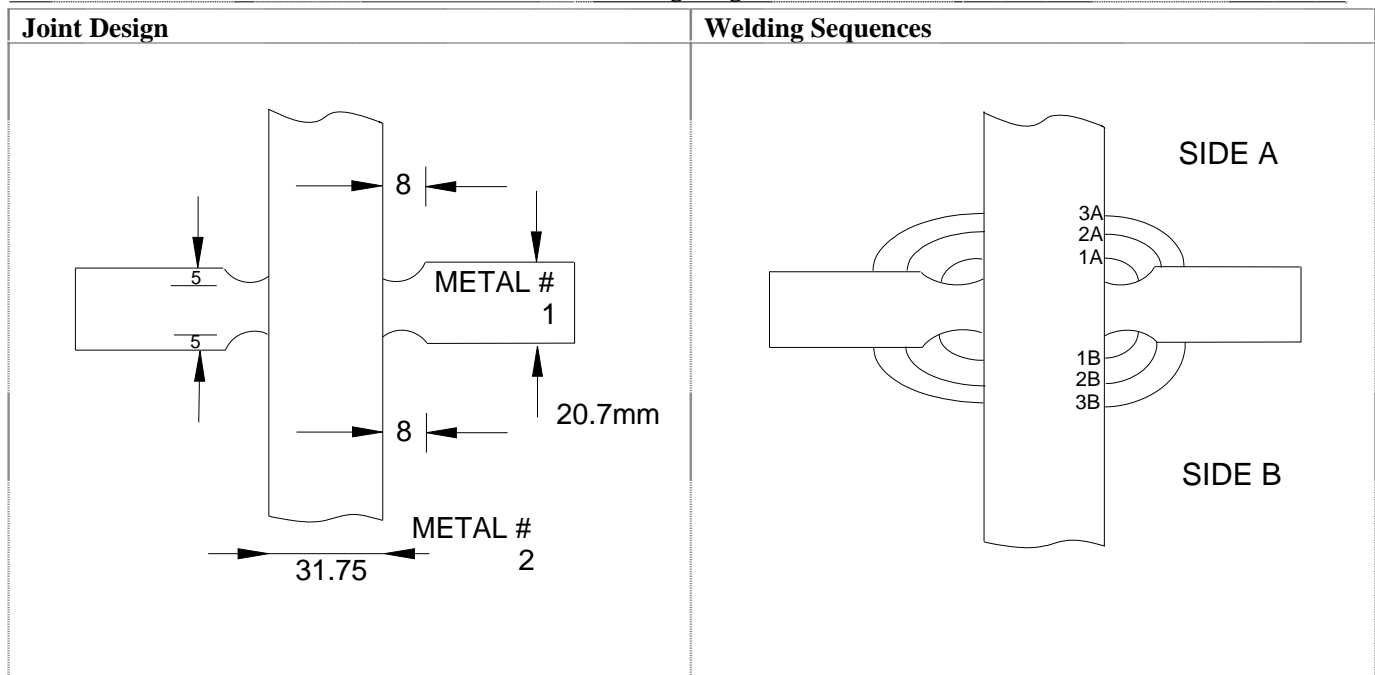

MELBOURNE OFFICE: PHONE (03) 9687 0000 FAX: (03) 9687 1900  
PROUDLY MANUFACTURING IN AUSTRALIA

# Temperature Controls Pty Ltd



Quality  
Endorsed  
Company

7 YAMMA STREET SEFTON, NSW 2162 AUSTRALIA

Phone: 61 2 9721 8644

Fax: 61 2 9738 9339

Web: [www.temperature.com.au](http://www.temperature.com.au)

Email: [sales@temperature.com.au](mailto:sales@temperature.com.au)

ACN: 650 190 183 ABN: 966 501 901 83

ISO 9001

Lic: 14412

## THERMOCOUPLES \* RTD SENSORS \* THERMOWELLS \* EXTENSION CABLES \* LEVEL SWITCHES

Run Sequence	Process	Size Of Filler Metal	Current A	Voltage V	Type Of Current/Polarity	Wire Feed Speed	Travel Speed	Heat Input
1A	GTAW	2.4	130	11	DC	N/A	N/A	N/A
1B	GTAW	2.4	130	11	DC	N/A	N/A	N/A
2A	GTAW	2.4	130	11	DC	N/A	N/A	N/A
2B	GTAW	2.4	130	11	DC	N/A	N/A	N/A
3A	GTAW	2.4	130	11	DC	N/A	N/A	N/A
3B	GTAW	2.4	130	11	DC	N/A	N/A	N/A
Welding Consumables: -			2.4 X 1000 mm Rod		<b>Production Sequence</b>			
Type, Designation Trade Name:			AWS/ASME SFA – 5.9 ER 316L Si HT 155057		1. Clean weld and 25mm borders to bright metal using approved degreasing solvent.			
Any Special Baking or Drying:			N/A		2. Position items to be welded ensuring good fit up.			
Gas Gas Flow Rate - Shield: - Backing:			ARGON 4.2 LINDE N/A		3. Tack weld parts together using TIG, tacks to at least 5mm min length, align using lathe if required			
Tungsten Electrode Type/ Size: Details of Back Gouging/Backing: Preheat Temperature:			2% Thoriated 2.4mm Dia Gas Backing 50 Deg C		4. deposit root run using 2.4mm dia. wire			
Method of preheat			CONVECTION OVEN		5. inspect root run internally			
Interpass temperature:			/ 50 DEG C		6. Complete weld using 2.4mm dia wire using stringer beads as required.			
Method of checking Interpass temperature			Hand Held Digital Thermocouple		7. 100% Visual inspection of completed weld			
<b>Post Weld Heat Treatment</b>			Not Required					
Time, temperature, method: Heating and Cooling Rates*:								
Edge Preparation Method			Lathe Machined					
Method of fit up								

### Revision History

Date	Issue	Changes	Authorization

MELBOURNE OFFICE: PHONE (03) 9687 0000 FAX: (03) 9687 1900  
PROUDLY MANUFACTURING IN AUSTRALIA